



# BSI British Standards

## **Selection and dimensioning of high-voltage insulators intended for use in polluted conditions —**

Part 2: Ceramic and glass insulators for  
a.c. systems

NO COPYING WITHOUT BSI PERMISSION EXCEPT AS PERMITTED BY COPYRIGHT LAW

*raising standards worldwide™*

### National foreword

This Draft for Development is the UK implementation of IEC/TS 60815-2:2008.

**This publication is not to be regarded as a British Standard.**

It is being issued in the Draft for Development series of publications and is of a provisional nature. It should be applied on this provisional basis, so that information and experience of its practical application can be obtained.

Comments arising from the use of this Draft for Development are requested so that UK experience can be reported to the international organization responsible for its conversion to an international standard. A review of this publication will be initiated not later than three years after its publication by the international organization so that a decision can be taken on its status. Notification of the start of the review period will be made in an announcement in the appropriate issue of Update Standards.

According to the replies received by the end of the review period, the responsible BSI Committee will decide whether to support the conversion into an international Standard, to extend the life of the Technical Specification or to withdraw it. Comments should be sent to the Secretary of the responsible BSI Technical Committee at British Standards House, 389 Chiswick High Road, London W4 4AL.

The UK participation in its preparation was entrusted to Technical Committee PEL/36, Insulators for power systems.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

©BSI 2009

ISBN 978 0 580 53558 1

ICS 29.080.10

**Compliance with a British Standard cannot confer immunity from legal obligations.**

This Draft for Development was published under the authority of the Standards Policy and Strategy Committee on 30 June 2009

### Amendments issued since publication

Amd. No.	Date	Text affected
----------	------	---------------

---



# TECHNICAL SPECIFICATION

---

**Selection and dimensioning of high-voltage insulators intended for use in  
polluted conditions –  
Part 2: Ceramic and glass insulators for a.c. systems**

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

PRICE CODE

**S**

ICS 29.080.10

ISBN 2-8318-1015-5

## CONTENTS

FOREWORD.....	4
1 Scope and object.....	6
2 Normative references .....	6
3 Terms, definitions and abbreviations .....	6
3.1 Terms and definitions .....	7
3.2 Abbreviations .....	7
4 Principles .....	7
5 Materials .....	8
6 Site severity determination .....	8
7 Determination of the reference unified specific creepage distance (RUSCD) .....	8
8 Choice of profile .....	9
8.1 General recommendations for porcelain and glass profiles .....	9
8.2 Profile suitability.....	12
9 Checking the profile parameters .....	12
9.1 Alternating sheds and shed overhang.....	15
9.2 Spacing versus shed overhang.....	15
9.3 Minimum distance between sheds .....	16
9.4 Creepage distance versus clearance .....	16
9.5 Shed angle .....	17
9.6 Creepage factor .....	17
10 Correction of the RUSCD.....	17
10.1 Correction for altitude $K_a$ .....	18
10.2 Correction for insulator diameter $K_{ad}$ .....	18
11 Determination of the required minimum nominal creepage distance.....	19
12 Confirmation by testing.....	19
12.1 Determination of the long-duration withstand voltage.....	19
12.2 Selection of the standard pollution withstand test type.....	19
12.3 Artificial pollution test parameters.....	20
12.4 Criteria of confirmation .....	21
Bibliography.....	22
Figure 1 – RUSCD as a function of SPS class .....	9
Figure 2 – Typical “standard” profiles.....	10
Figure 3 – Typical “open” profiles.....	11
Figure 4 – Typical “anti-fog” profiles.....	11
Figure 5 – Typical “alternating” profiles .....	11
Figure 6 – Typical pin insulator shed profiles .....	12
Figure 7 – $K_{ad}$ as a function of insulator diameter .....	18

Table 1 – Principal advantages (+) and disadvantages (-) of main profile types .....	10
Table 2 – Profile suitability, relative to a standard profile, for porcelain and glass insulators assuming the same creepage distance per unit or string .....	13
Table 3 – Profile suitability, relative to a standard profile, for porcelain and glass insulators assuming the same insulating length .....	14
Table 4 – Artificial pollution test parameters for confirmation by testing .....	20

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**SELECTION AND DIMENSIONING OF HIGH-VOLTAGE INSULATORS  
INTENDED FOR USE IN POLLUTED CONDITIONS –****Part 2: Ceramic and glass insulators for a.c. systems**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. In exceptional circumstances, a technical committee may propose the publication of a technical specification when

- the required support cannot be obtained for the publication of an International Standard, despite repeated efforts, or
- the subject is still under technical development or where, for any other reason, there is the future but no immediate possibility of an agreement on an International Standard.

Technical specifications are subject to review within three years of publication to decide whether they can be transformed into International Standards.

IEC/TS 60815-2, which is a technical specification, has been prepared by technical committee 36: Insulators.

This first edition of IEC/TS 60815-2, together with IEC/TS 60815-1, cancels and replaces IEC/TR 60815, which was issued as a technical report in 1986. It constitutes a technical

revision and now has the status of a technical specification. The text of this technical specification is based on the following documents:

Enquiry draft	Report on voting
36/265/DTS	36/271A/RVC

Full information on the voting for the approval of this technical specification can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2

A list of all the parts in the future IEC 60815 series, under the general title *Selection and dimensioning of high-voltage insulators intended for use in polluted conditions*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- transformed into an International standard,
- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

A bilingual version of this publication may be issued at a later date.

## SELECTION AND DIMENSIONING OF HIGH-VOLTAGE INSULATORS INTENDED FOR USE IN POLLUTED CONDITIONS –

### Part 2: Ceramic and glass insulators for a.c. systems

#### 1 Scope and object

IEC/TS 60815-1, which is a technical specification, is applicable to the selection of ceramic and glass insulators for a.c. systems, and the determination of their relevant dimensions, to be used in high-voltage systems with respect to pollution.

This part of IEC 60815 gives specific guidelines and principles to arrive at an informed judgement on the probable behaviour of a given insulator in certain pollution environments.

The basis for the structure and approach of this part of IEC 60815 is fully explained in IEC/TS 60815-1.

The object of this technical specification is to give the user means to:

- determine the reference unified specific creepage distance (RUSCD) from site pollution severity (SPS) class;
- evaluate the suitability of different insulator profiles;
- determine the necessary USCD by applying corrections for insulator shape, size, position, etc. to the RUSCD;
- if required, determine the appropriate test methods and parameters to verify the performance of the selected insulators.

#### 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60050-471, *International Electrotechnical Vocabulary – Part 471: Insulators*

IEC 60507, *Artificial pollution tests on high-voltage insulators to be used on a.c. systems*

IEC/TS 60815-1, *Selection and dimensioning of high-voltage insulators for polluted conditions – Part 1: Definitions information and general principles*

#### 3 Terms, definitions and abbreviations

For the purposes of this document, the following terms, definitions and abbreviations apply. The definitions given below are those which either do not appear in IEC 60050-471 or differ from those given in IEC 60050-471.



### 3.1 Terms and definitions

#### 3.2

#### **unified specific creepage distance**

#### **USCD**

creepage distance of an insulator divided by the r.m.s. value of the highest operating voltage across the insulator

NOTE 1 This definition differs from that of specific creepage distance where the line-to-line value of the highest voltage for the equipment is used (for a.c. systems usually  $U_m/\sqrt{3}$ ). For line-to-earth insulation, this definition will result in a value that is  $\sqrt{3}$  times that given by the definition of specific creepage distance in IEC/TR 60815 (1986).

NOTE 2 For ' $U_m$ ' see IEC 604-03-01 [1]<sup>1</sup>.

NOTE 3 It is generally expressed in mm/kV and usually expressed as a minimum.

#### 3.3

#### **reference unified specific creepage distance**

#### **RUSCD**

initial value of unified specific creepage distance for a pollution site before correction for size, profile, mounting position, etc. according to this technical specification and generally expressed in mm/kV

### 3.4 Abbreviations

CF	creepage factor
ESDD	equivalent salt deposit density
NSDD	non soluble deposit density
SDD	salt deposit density
SES	site equivalent salinity
SPS	site pollution severity
USCD	unified specific creepage distance
RUSCD	reference unified specific creepage distance

## 4 Principles

The overall process of insulation selection and dimensioning can be summarized as follows:

Firstly, using IEC/TS 60815-1:

- determine the appropriate approach: 1, 2 or 3 as a function of available knowledge, time and resources;
- collect the necessary input data, notably system voltage, insulation application type (line, post, bushing, etc.);
- collect the necessary environmental data, notably site pollution severity and class.

At this stage, a preliminary choice of possible candidate insulators suitable for the applications and environment may be made.

Then, using this technical specification:

- refine the choice of possible candidate ceramic or glass insulators suitable for the environment;

<sup>1</sup> References in square brackets refer to the bibliography.

- determine the reference USCD for the insulator types and materials, either using the indications given in this technical specification, or from service or test station experience in the case of approach 1 (Clause 7);
- choose suitable profiles for the type of environment (Clause 8);
- verify that the profile satisfies certain parameters, with correction or action according to the degree of deviation (Clause 9);
- modify, where necessary (approaches 2 and 3), of the RUSCD by factors depending on the size, profile, orientation, etc. of the candidate insulator (Clauses 10 and 11);
- verify that the resulting candidate insulators satisfy the other system and line requirements such as those given in Table 2 of IEC/TS 60815-1 (e.g. imposed geometry, dimensions, economics);
- verify the dimensioning, if required in the case of approach 2, by laboratory tests (see Clause 12).

NOTE Without sufficient time and resources (i.e. using approach 3), the determination of the necessary USCD will have less accuracy.

## 5 Materials

This technical specification is applicable to ceramic and glass insulators. The guidance given here assumes that the insulators are of standard manufacture without any surface modification or treatment.

Technologies exist intended to improve the performance of such insulators under pollution, for example, semi-conducting glaze and hydrophobic coatings. At present it is not possible to give specific information on the degree and durability of the improvement given by such technologies.

As far as the relative performance of ceramic and glass insulators under pollution is concerned, there is no notable consistent difference between these materials; hence the choice of either glass or ceramic material with respect to the other depends purely on factors (e.g. ageing, operating experience, maintenance procedures) which are out of the scope of this technical specification.

## 6 Site severity determination

For the purposes of standardization, five classes of pollution characterizing the site severity are qualitatively defined in IEC/TS 60815-1, from very light pollution to very heavy pollution, as follows:

- a – Very light;
- b – Light;
- c – Medium;
- d – Heavy;
- e – Very heavy.

NOTE These letter classes do not correspond directly to the previous number classes of IEC/TR 60815:1986.

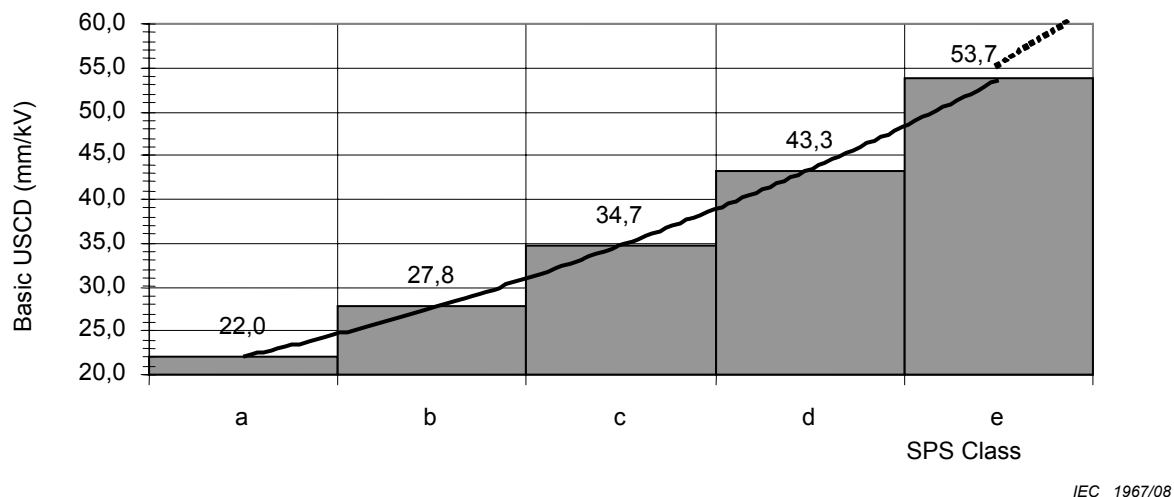
The SPS class for the site is determined according to IEC/TS 60815-1 and is used to determine the reference USCD for glass and ceramic insulators.

## 7 Determination of the reference unified specific creepage distance (RUSCD)

Figure 1 shows the relation between SPS class and RUSCD for glass and ceramic insulators. The bars are preferred values representative of a minimum requirement for each class and

are given for use with approach 3 as described in IEC/TS 60815-1. If the estimation of SPS class tends towards the neighbouring higher class, then the curve may be followed.

If exact SPS measurements are available (approach 1 or 2), it is recommended to take a RUSCD which corresponds to the position of the SPS measurements within the class by following the curve in Figure 1.



**Figure 1 – RUSCD as a function of SPS class**

In cases of exceptionally high SPS in, or beyond, class e (see IEC/TS 60815-1, 8.2) the minimum RUSCD may not be adequate. Depending on service experience and/or laboratory test results a higher USCD can be used; in some instances mitigation may be useful (see IEC/TS 60815-1, 9.5.5).

**NOTE** It is assumed that the final USCD resulting from the application of the corrections given hereafter to the RUSCD will not correspond exactly to a creepage distance available for catalogue insulators. Hence it is preferred to work with exact figures and to round up to an appropriate value at the end of the correction process.

## 8 Choice of profile

### 8.1 General recommendations for porcelain and glass profiles

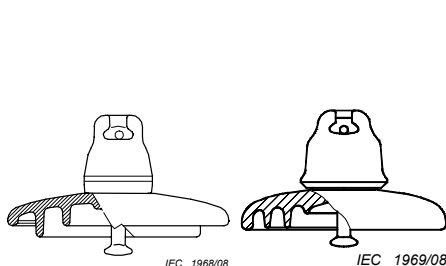
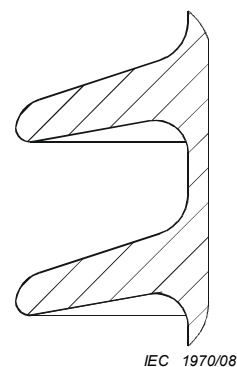
Table 1 below shows a brief summary of the principal advantages and disadvantages of the main profile types with respect to pollution performance.

For standard profiles see Figure 2.

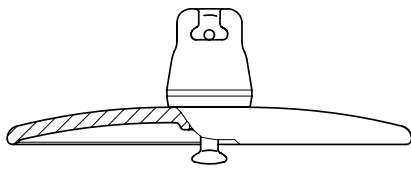
**NOTE** In the case of long rods, posts and hollows, the typical standard profile shed inclinations are  $14^\circ$  -  $24^\circ$  for the shed top angle  $\alpha$  and  $8^\circ$  -  $16^\circ$  for the shed bottom angle  $\beta$  (illustrated in Figure 2b). Smaller angles are generally considered as being aerodynamic, while larger angles are considered as being anti-fog.

**Table 1 – Principal advantages (+) and disadvantages (-) of main profile types**


Mounting		Standard profile	Open profile	Anti-fog profile	Alternating shed arrangements
Vertical	+	Good experience from use in very light to medium SPS classes where a long creepage distance or aerodynamically effective profile is not required	Collects less pollution, due to aerodynamic profile and good natural cleaning	Prevents wetting of whole under side during rain, mist, etc.  Long creepage distance per unit	<p>Represents the relevant advantages and disadvantages of the individual profile types: standard, open or anti-fog with the benefits of</p> <ul style="list-style-type: none"> <li>- increased creepage distance per unit</li> <li>- good withstand capability under heavy wetting</li> <li>- good withstand capability under icing</li> </ul>
	-	Does not avoid collection of wind-born deposits	Total surface collects more pollution in rapid accumulation conditions, such as storms, typhoons, etc., requires longer strings. Good experience from use in very light to medium SPS classes (in particular dry and semidry regions) where aerodynamically effective profile is required	More wind born deposit accumulates on the under-side due to reduced natural cleaning	
Horizontal	+	Collects less pollution because of natural cleaning by wetting	Collects less pollution, as the aerodynamic profile gives a better self-cleaning by wetting and wind	Long creepage distance per unit	
	-	Total surface becomes polluted but is accessible for natural cleaning	Total surface collects more pollution under rapid accumulation conditions, such as storms, typhoons, etc.  Requires a longer string length	Wind born deposit accumulates on surfaces with deep under-rib due to reduced natural cleaning	

**Figure 2a – Cap and pin standard disc insulators****Figure 2b – Standard shed profile – long rod insulators, post insulators, hollow insulators****Figure 2 – Typical “standard” profiles**


Aerodynamic or open profiles are shown in Figure 3 and anti-fog profiles are shown in Figure 4.




IEC 1971/08

**Figure 3a – Aerodynamic disc insulators**


IEC 1972/08

**Figure 3b – Aerodynamic sheds – Long rod insulators, post insulators, hollow insulators****Figure 3 – Typical “open” profiles**


IEC 1973/08

**Figure 4a – Steep anti-fog disc insulators**

IEC 1974/08

**Figure 4b – Steep anti-fog – long rod insulators, post insulators, hollow insulators**


IEC 1975/08

**Figure 4c – Deep under-ribs disc insulators**


IEC 1976/08

**Figure 4d – Deep under-ribs on long rod insulators, post insulators, hollow insulators****Figure 4 – Typical “anti-fog” profiles**

For the purposes of this technical specification, an alternating shed arrangement is defined as having a minimum difference in shed overhang of at least 15 mm (see Figure 5 and 9.4).




IEC 1977/08

**Figure 5a – Alternating shed disc insulators**

IEC 1978/08

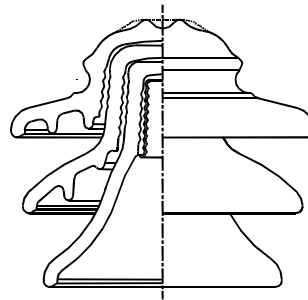
**Figure 5b – Alternating sheds on long rod insulators, post insulators, hollow insulators****Figure 5 – Typical “alternating” profiles**

Typical pin insulator shed profiles are shown in Figure 6. In general, pin insulator profiles can be assimilated to anti-fog profiles and are therefore not dealt with separately in the following.



IEC 1979/08

Figure 6a – Single-piece pin insulator



IEC 1980/08

Figure 6b – Multi-element pin insulator

Figure 6 – Typical pin insulator shed profiles

## 8.2 Profile suitability

Tables 2 and 3 give simple merit values for insulator profiles. In each case the merit value of each profile, relative to a standard profile, for use in specific areas is given as follows:

- ++ suitable, best choice;
- + suitable;
- 0 neutral, no particular advantage or disadvantage;
- unsuitable, but can be used;
- unsuitable, avoid this choice if possible.

Pollution is often not the sole parameter used for the choice of insulator profile. The insulator material, design, manufacturing process or application may preclude certain profiles. Hence the optimal profile may not be available for the combination of insulator/pollution type. Therefore, the choice or use of a less suitable profile is not excluded.

If an unsuitable profile is chosen, then it is recommended that the RUSCD be chosen from Figure 1 towards the upper end of the SPS class or even for the next higher class, unless such a change would cause, or aggravate, a deviation of the profile parameters in Clause 9. If an unsuitable profile is chosen which also has a minor deviation in profile parameters, then it is recommended to treat this profile as if it has a major deviation in profile parameters (see Clause 9).

## 9 Checking the profile parameters

### 9.1 Introductory remark

NOTE The profile parameters used in the following sub-clauses are based on the nominal design dimensions figuring on the detailed insulator drawing. They are not intended for verification during normal acceptance testing specified by product standards.

The following profile parameters have a normal (white) range, a grey range where they can reduce performance (minor deviation) and a black range where they can have a serious negative effect on performance under pollution (major deviation). Each parameter shall be calculated and checked according to the following. It is allowed for one parameter to deviate into a grey area, i.e. to have a minor deviation. In the case of a minor deviation, it is recommended that the RUSCD be chosen from Figure 1 towards the upper end of the SPS class or even for the next higher class, unless such a change would further aggravate the deviation. If more than one parameter is in a grey area, or any parameter in a black area, then this is considered as a major deviation and it is recommended to do one of the following:

- consult data from service or test station experience to confirm the performance of the profile;

- find an alternative profile or insulator technology;
- verify the performance of the profile by testing (see Clause 12).

**Table 2 – Profile suitability, relative to a standard profile, for porcelain and glass insulators assuming the same creepage distance per unit or string**


Environment type	Profile suitability	Standard profile <sup>a</sup> All types	Open profile <sup>b</sup>		Anti-fog profile All types
			Disc/ long rod	Post/hollow	
Desert	++				
	+		●		
	0	●□	□	●□	□ (Both)
	-				● (Vertical)
	--				● (Horizontal)
Coastal	++				□ (Vertical)
	+				● (Vertical)
	0	●□	● <sup>c</sup>	●□	●□ (Horizontal)
	-		□		
	--				
Industrial	++				
	+		●		
	0	●□	□	●□	□
	-				●
	--				
Agricultural	++				
	+				
	0	●		●	
	-		●		● (Vertical)
	--				● (Horizontal)
Inland (low pollution)	++				
	+				
	0	●	●	●	●
	-				
	--				
KEY		<p><sup>a</sup> The standard profile is taken as the reference "0" level. This does not automatically make the standard profile suitable for all applications, since in certain cases it cannot supply the necessary creepage distance within the required insulating length</p> <p><sup>b</sup> Alternating shed arrangements are mainly categorized in open profile.</p> <p><sup>c</sup> For the areas where rapid pollution due to typhoons or similar events are anticipated, an open profile will collect more pollutants in a short period than a standard or anti-fog profile, hence its suitability may be reduced.</p>			
● Type A pollution					
□ Type B pollution					

**Table 3 – Profile suitability, relative to a standard profile, for porcelain and glass insulators assuming the same insulating length**

Environment type	Profile suitability	Standard profile <sup>a</sup> All types	Open profile <sup>b</sup>		Anti-fog profile All types
			Disc/ long rod	Post/hollow	
Desert	++		●		
	+		□	●□	● (Vertical) □ (Both)
	0	●□			● (Horizontal)
	-				
	--				
Coastal	++				● (Vertical) □ (Vertical)
	+		● <sup>c</sup>	●□	● (Horiz.) □ (Horiz.)
	0	●□	□		
	-				
	--				
Industrial	++				
	+		●		● (Vertical) □
	0	●□	□	●□	● (Horizontal)
	-				
	--				
Agricultural	++				
	+				● (Vertical)
	0	●	●	●	
	-				● (Horizontal)
	--				
Inland (low pollution)	++				
	+				
	0	●	●	●	●
	-				
	--				
KEY		<p><sup>a</sup> The standard profile is taken as the reference "0" level. This does not automatically make the standard profile suitable for all applications, since in certain cases it cannot supply the necessary creepage distance within the required insulating length.</p> <p><sup>b</sup> Alternating shed arrangements are mainly categorized in open profile.</p> <p><sup>c</sup> For the areas where rapid pollution due to typhoons or similar events are anticipated, an open profile will collect more pollutants in a short period than a standard or anti-fog profile, hence its suitability may be reduced.</p>			
● Type A pollution					
□ Type B pollution					





## 9.2 Alternating sheds and shed overhang

	<p>The classification of a profile as being alternating or not is based on difference in shed overhang measured from the insulator trunk to the tips of the largest and smallest sheds.</p> <p><i>Shed overhang alone is not an important parameter, as long as the shed angle is not essentially flat (<math>&lt; 5^\circ</math>), or excessive (<math>&gt; 35^\circ</math>). The parameter is useful for defining uniform shed diameter profiles compared to alternating shed diameter profiles. However larger values of difference in shed overhang may be beneficial for vertical insulators in ice, snow and heavy rain conditions.</i></p> <p>Not applicable to cap and pin insulators or multi-shed pin insulators</p>
---	--

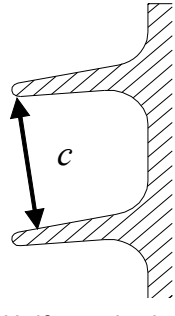
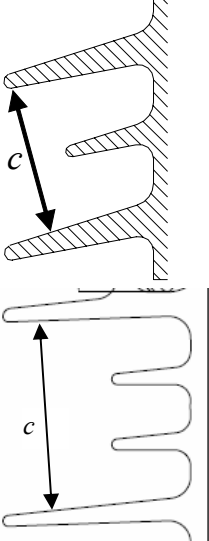
Classification of profile		
	Non-alternating	Alternating
All insulators	$p_1 = p_2$ or $p_1 - p_2 < 15 \text{ mm}$	$p_1 - p_2 \geq 15 \text{ mm}$

## 9.3 Spacing versus shed overhang

 <p>Uniform sheds</p>	 <p>Alternating sheds</p>	<p>Spacing versus shed overhang is ratio of the vertical distance between two similar points of successive sheds of the same diameter (spacing) and the maximum shed overhang.</p> <p><i>This parameter, as well as those described in 9.5, 9.6 and 9.7, involve shed-to-shed spacing and are important for the avoidance of "shorting out" creepage distance bridged by a shed-to-shed arc.</i></p> <p>Not applicable to cap and pin insulators or multi-shed pin insulators</p>
--	--	---



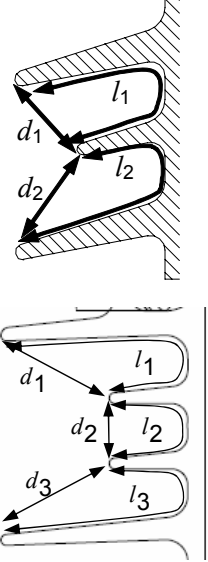
		Deviations for $s/p$									
Sheds with under ribs	Major					Minor					
Sheds without under ribs	Major			Minor				None			
$s/p$		0,4	0,5	0,6	0,65	0,7	0,75	0,8	0,9	1	

## 9.4 Minimum distance between sheds

 <p>Uniform sheds</p>	 <p>Alternating sheds</p>	<p><math>c</math> is the minimum distance between adjacent sheds of the same diameter, measured by drawing a perpendicular from the lowest point of rim of the upper shed to the next shed below of the same diameter.</p> <p><i>Minimum distance between sheds is one of the more important characteristics for insulator profile evaluation. Shed-to-shed arcing for small shed spacing can negate any effort to improve performance by adding creepage distance.</i></p> <p>Not applicable to cap and pin insulators or pin insulators</p>
--	--	---


		Deviations for $c$						
Insulator length >550 mm		Major		Minor	None			
Insulator length ≤550 mm		Major		Minor	None			
$c$ (mm)		15	20	25	30	35	40	45

## 9.5 Creepage distance versus clearance

 <p>Plain sheds</p>  <p>Cap and pin</p>	 <p>Alternating sheds</p>	<p><math>d</math> is the straight air distance between two points on the insulating part or between a point on the insulating part and another on a metal part.</p> <p><math>l</math> is the part of the creepage distance measured between the above two points.</p> <p><math>l/d</math> is the highest ratio found on any section, for example on the underside of a cap and pin insulator.</p> <p><i>Creepage distance versus clearance is a more localized check of the risk of bridging by arcs when dry bands or uneven hydrophobicity occur. It is also important in avoiding localized pollution build-up in deep and narrow sections of the profile</i></p>
---	--	--

		Deviations for $l/d$						
All profiles		None			Minor	Major		
$l/d$		1	2	3	4	5	6	7

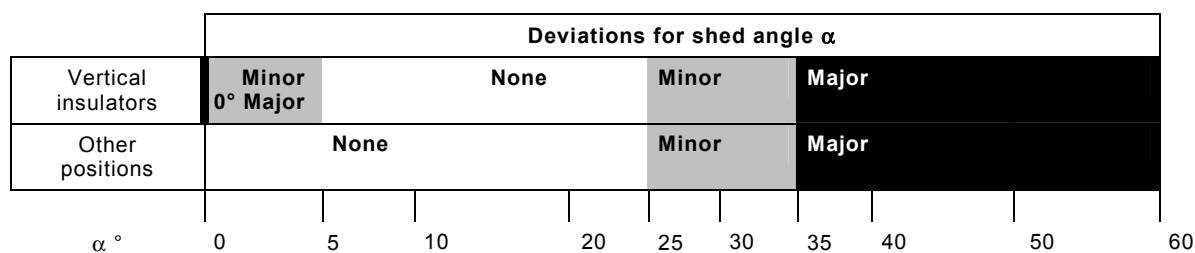
## 9.6 Shed angle



For rounded sheds,  $\alpha$  is measured at the mid-point.

*Open profiles allow for more efficient natural washing of insulator surfaces, provided the shed angle is not so low as to impede excess water run-off.*

Not applicable to pin insulators



## 9.7 Creepage factor

CF is equal to  $l/S$

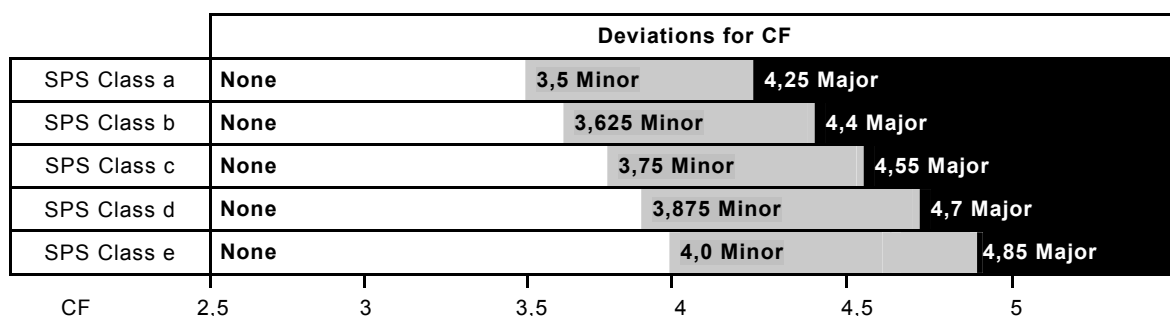
where

$l$  is the total nominal creepage distance of the insulator;

$S$  is the arcing distance of the insulator.

For cap and pin insulators, CF is determined for a string of 5 insulators or more.

*Creepage factor is a global check of the overall density of creepage distance. If the requirements in 9.1, 9.2 and 9.3 are met, the creepage factor requirement is usually automatically respected*



## 10 Correction of the RUSCD

### 10.1 Introductory remark

The following corrections, where applicable, shall be applied to the reference unified specific creepage distance (RUSCD) determined after analysis according to Clause 9 above. All the factors are multipliers, as follows:

$$\text{Corrected USCD} = \text{RUSCD} \times K_a \times K_{ad}$$

## 10.2 Correction for altitude $K_a$

The influence of altitude on impulse withstand voltages is generally much greater than on pollution withstand performance. In general, the increase in insulation length necessary for impulse voltages at higher altitudes results in more than sufficient increase in creepage distance. This means, if not otherwise clearly stated by the purchaser of the insulator, usually  $K_{ad} = 1$ . If nevertheless, correction is required, notably for altitudes above 1 500 m where there is no previous operating experience, then correction can be used based on [1].

## 10.3 Correction for insulator diameter $K_{ad}$

For long rod, post and hollow insulators correct for average diameter  $D_a$  by:

$K_{ad} = 1$  when  $D_a$  is smaller than 300 mm;

$K_{ad} = 0,000\ 5\ D_a + 0,85$  when  $D_a$  is equal to or larger than 300 mm

The average diameter  $D_a$  is given by

$$D_a = \frac{\int_0^l D(x) dx}{l}$$

where  $D(x)$  is the value of the diameter at a creepage distance  $x$ , measured from one electrode and  $l$  is the total nominal creepage distance of the insulator.

The above formula may be approximated in general by the following simple relation:

$$D_a = (2D_t + D_{s1} + D_{s2})/4$$

( $D_{s1}=D_{s2}$  for non-alternating sheds)

For complex shed repetitions, add each extra diameter to the numerator and add 2 to the denominator.

In case of conflict or doubt this approximation shall not be used.

NOTE This correction takes into account both the reduced withstand performance and the reduced pollution accumulation of larger diameter insulators. The dotted line in the following Figure 7 shows the equivalent correction without the influence of reduced pollution accumulation, e.g. for artificial pollution testing.

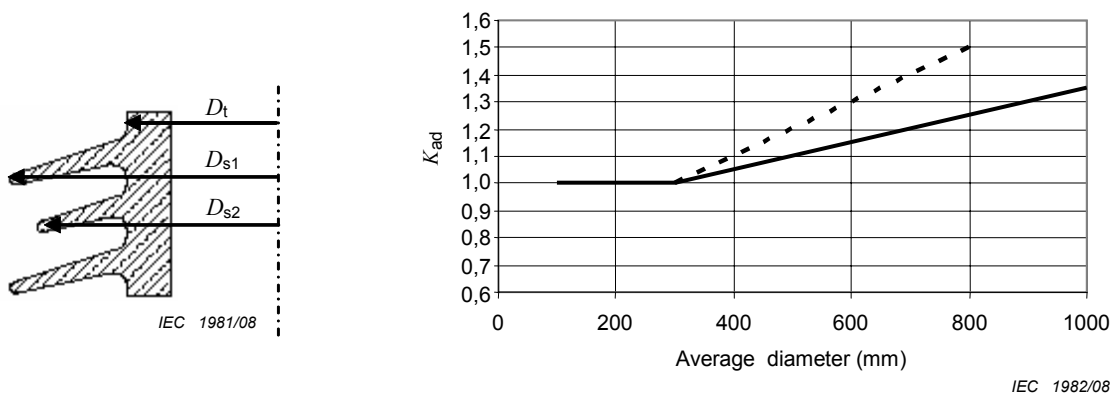


Figure 7 –  $K_{ad}$  as a function of insulator diameter

## 11 Determination of the required minimum nominal creepage distance

Once the RUSCD has been corrected according to Clause 10, the final minimum creepage distance is determined for the candidate insulator by rounding up to the nearest creepage distance available for that type of insulator within the constraints (system, dimensional, etc.).

For example, a final USCD of 36,5 mm/kV is found for a certain candidate cap and pin insulator. The system maximum phase-to-earth voltage is 228 kV. The required minimum creepage distance is therefore  $228 \text{ mm} \times 36,5 \text{ mm} = 8\,322 \text{ mm}$ . The creepage distance of each cap and pin insulator unit is 380 mm, requiring 21,9 units. Therefore the final minimum creepage distance will be  $22 \text{ mm} \times 380 \text{ mm} = 8\,360 \text{ mm}$ .

## 12 Confirmation by testing

### 12.1 Introductory remark

The general principles of using laboratory testing for insulator selection and dimensioning is described in IEC/TS 60815-1. The laboratory test is specified in terms of the long-duration withstand voltage, and the required pollution severity withstand level.

### 12.2 Determination of the long-duration withstand voltage

The long-duration withstand voltage at which the laboratory test is performed is equal to the maximum a.c. operating voltage that may appear across the insulator in service.

NOTE 1 For systems where long-duration temporary overvoltages occur, e.g. systems without earth fault clearing, the level of the expected temporary overvoltage should be taken into account when selecting the long-duration withstand voltage.

Tests may be performed on shorter insulator sections under the following conditions:

- the long-duration withstand voltage shall be adjusted to produce at least the same voltage stress per unit insulating length of the insulator;
- multi-unit insulator assemblies shall be tested as an assembly comprising more than one insulator unit;
- cap and pin insulator strings shall comprise at least of 3 insulator units.

NOTE 2 The insulating length refers to the shortest distance between fixing points of the live and earthed metal end fittings, ignoring the presence of any stress control rings, but including intermediate metal parts along the length of the insulator.

### 12.3 Selection of the standard pollution withstand test type

The relevant test method to be used is selected according to the type of pollution at the site, the type of insulator and the type of energization. The tests given in IEC 60507 are directly applicable to ceramic and glass insulators for a.c. systems.

As a general rule, the solid layer test is recommended for type A pollution and the salt-fog test for type B pollution.

The applicability of the required pollution severity withstand level to a specific site is

- dependent on whether the test method used can be considered representative of the intended environment, and
- restricted by the approximation and limitations inherent to the chosen laboratory test method.

The use of non-standard, or customized, laboratory pollution test methods may be necessary if the site of interest is not adequately represented by a standard laboratory test method. More information on such methods can be found in CIGRÉ 158 [1].

## 12.4 Artificial pollution test parameters

The determination of the pollution test severity consists of determining the withstand severity of the insulation which will meet the performance criterion when it is subjected to the highest voltage for the equipment.

The pollution test severity for deterministic methods or the performance data necessary for statistical methods are obtained according to the following Table 4.

**Table 4 – Artificial pollution test parameters for confirmation by testing**

Test	Deterministic method Standard withstand test	Statistical method						
<b>Solid layer tests</b>	<p>Either:</p> <p>Carry out a non-standard withstand test at the site ESDD and NSDD. This qualifies the equipment for a specific site.</p> <p>Or (preferred):</p> <p>Carry out a standard withstand test at a severity (SDD) chosen from the list below<sup>a</sup>, taking the first value above the site ESDD.</p> <p>For the following parameters, which have an established and quantifiable influence on pollution performance, the test severity can be adjusted as follows:</p> <p>NSDD: If site NSDD is higher than 0,1 mg/cm<sup>2</sup> – increase test SDD using the following steps:</p> <table border="1"> <tr> <td>0,1 &lt; NSDD ≤ 0,2 (mg/cm<sup>2</sup>)</td><td>0,2 &lt; NSDD ≤ 0,4 (mg/cm<sup>2</sup>)</td><td>0,4 &lt; NSDD ≤ 0,8 (mg/cm<sup>2</sup>)</td></tr> <tr> <td>1 SDD step</td><td>2 SDD steps</td><td>3 SDD steps</td></tr> </table> <p>If the NSDD is higher than 0,8 mg/cm<sup>2</sup> then perform the non-standard test at the measured NSDD.</p> <p>Diameter: For insulators with average diameter greater than 400 mm, decrease test SDD by one step</p> <p>This qualifies the equipment for a SPS class.</p> <p>Alternatively, the SDD value for laboratory tests can be more accurately determined from ESDD in service using the principles given in Annex F of IEC/TS60815-1.</p> <p>In other cases it is recommended to consult [1], [2] for information on the influence of salt types, wetting, etc. in order to determine appropriate solid layer test parameters for a representative non-standard test</p>	0,1 < NSDD ≤ 0,2 (mg/cm <sup>2</sup> )	0,2 < NSDD ≤ 0,4 (mg/cm <sup>2</sup> )	0,4 < NSDD ≤ 0,8 (mg/cm <sup>2</sup> )	1 SDD step	2 SDD steps	3 SDD steps	<p>Determine <math>U_{50}</math> curve from at least two test results at ESDD either side of the SPS. Use curve parameters in statistical analysis to verify required risk of flashover</p>
0,1 < NSDD ≤ 0,2 (mg/cm <sup>2</sup> )	0,2 < NSDD ≤ 0,4 (mg/cm <sup>2</sup> )	0,4 < NSDD ≤ 0,8 (mg/cm <sup>2</sup> )						
1 SDD step	2 SDD steps	3 SDD steps						
<sup>a</sup> Standard SDD values	0,0124 – 0,017 6 – 0,025 – 0,0353 – 0,05 – 0,070 5 – 0,1 – 0,141 – 0,20 – 0,4 – 0,8 – 1,0 – 1;41, 2,0 ... (mg/cm <sup>2</sup> )							
<b>Salt-fog tests</b>	<p>Carry out a standard withstand test at a salinity value chosen from the list below<sup>b</sup> by taking the first value above the SES.</p> <p>Alternatively, the salinity value for laboratory tests can be more accurately determined from SES in service using the principles given in Annex F of IEC/TS 60815-1</p>	<p>Determine <math>U_{50}</math> or the withstand curve from at least two test results at salinity either side of the SES. Use curve parameters in statistical analysis to verify required risk of flashover</p>						
<sup>b</sup> Standard salinity values	2,5 – 3,5 – 5 – 7 – 10 – 14 – 20 – 28 – 40 – 56 – 80 – 112 – 160 – 224 (kg/m <sup>3</sup> )							

### **12.5 Criteria of confirmation**

Insulators that pass the withstand tests at the required pollution severity, or higher, are deemed to be correctly dimensioned for the envisaged application and conditions.

## Bibliography

- [1] IEC 60050-604, *International Electrotechnical Vocabulary – Part 604: Generation, transmission and distribution of electricity – Operation*
  - [2] CIGRE Taskforce 33.04.01 – *Polluted insulators: A review of current knowledge*, CIGRE brochure N° 158-2000
  - [3] CIGRE WG C4.303 – *Outdoor insulation in polluted conditions: Guidelines for selection and dimensioning – Part 1: General principles and the a.c. case*, CIGRE Technical Brochure N° 361-2008
  - [4] CIGRE Taskforce 33.13.07 – *Influence of Ice and snow on the flashover performance of outdoor insulators – Part 1: Effects of Ice*, ELECTRA No. 187 December 1999, and Part 2: *Effects of Snow*, ELECTRA No. 188 February 2000.
  - [5] *CIGRE Taskforce 33.04.03 – Insulator pollution monitoring*, Electra 152, February 1994
-





# British Standards Institution (BSI)

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level.

It is incorporated by Royal Charter.

## Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover.

**Tel: +44 (0)20 8996 9000 Fax: +44 (0)20 8996 7400**

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

## Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to BSI Customer Services.

**Tel: +44 (0)20 8996 9001 Fax: +44 (0)20 8996 7001**  
**Email: [orders@bsigroup.com](mailto:orders@bsigroup.com)**

You may also buy directly using a debit/credit card from the BSI Shop on the website **[www.bsigroup.com/shop](http://www.bsigroup.com/shop)**

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

## Information on standards

BSI provides a wide range of information on national, European and international standards through its Library.

Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre.

**Tel: +44 (0)20 8996 7111**

**Fax: +44 (0)20 8996 7048 Email: [info@bsigroup.com](mailto:info@bsigroup.com)**

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration.

**Tel: +44 (0)20 8996 7002 Fax: +44 (0)20 8996 7001**

**Email: [membership@bsigroup.com](mailto:membership@bsigroup.com)**

Information regarding online access to British Standards via British Standards Online can be found at **[www.bsigroup.com/BSOL](http://www.bsigroup.com/BSOL)**

Further information about BSI is available on the BSI website at **[www.bsigroup.com](http://www.bsigroup.com)**

## Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained. Details and advice can be obtained from the Copyright & Licensing Manager.

**Tel: +44 (0)20 8996 7070 Email: [copyright@bsigroup.com](mailto:copyright@bsigroup.com)**

## BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK

Tel +44 (0)20 8996 9001

Fax +44 (0)20 8996 7001

[www.bsigroup.com/standards](http://www.bsigroup.com/standards)

*raising standards worldwide™*

**BSI**  
British Standards