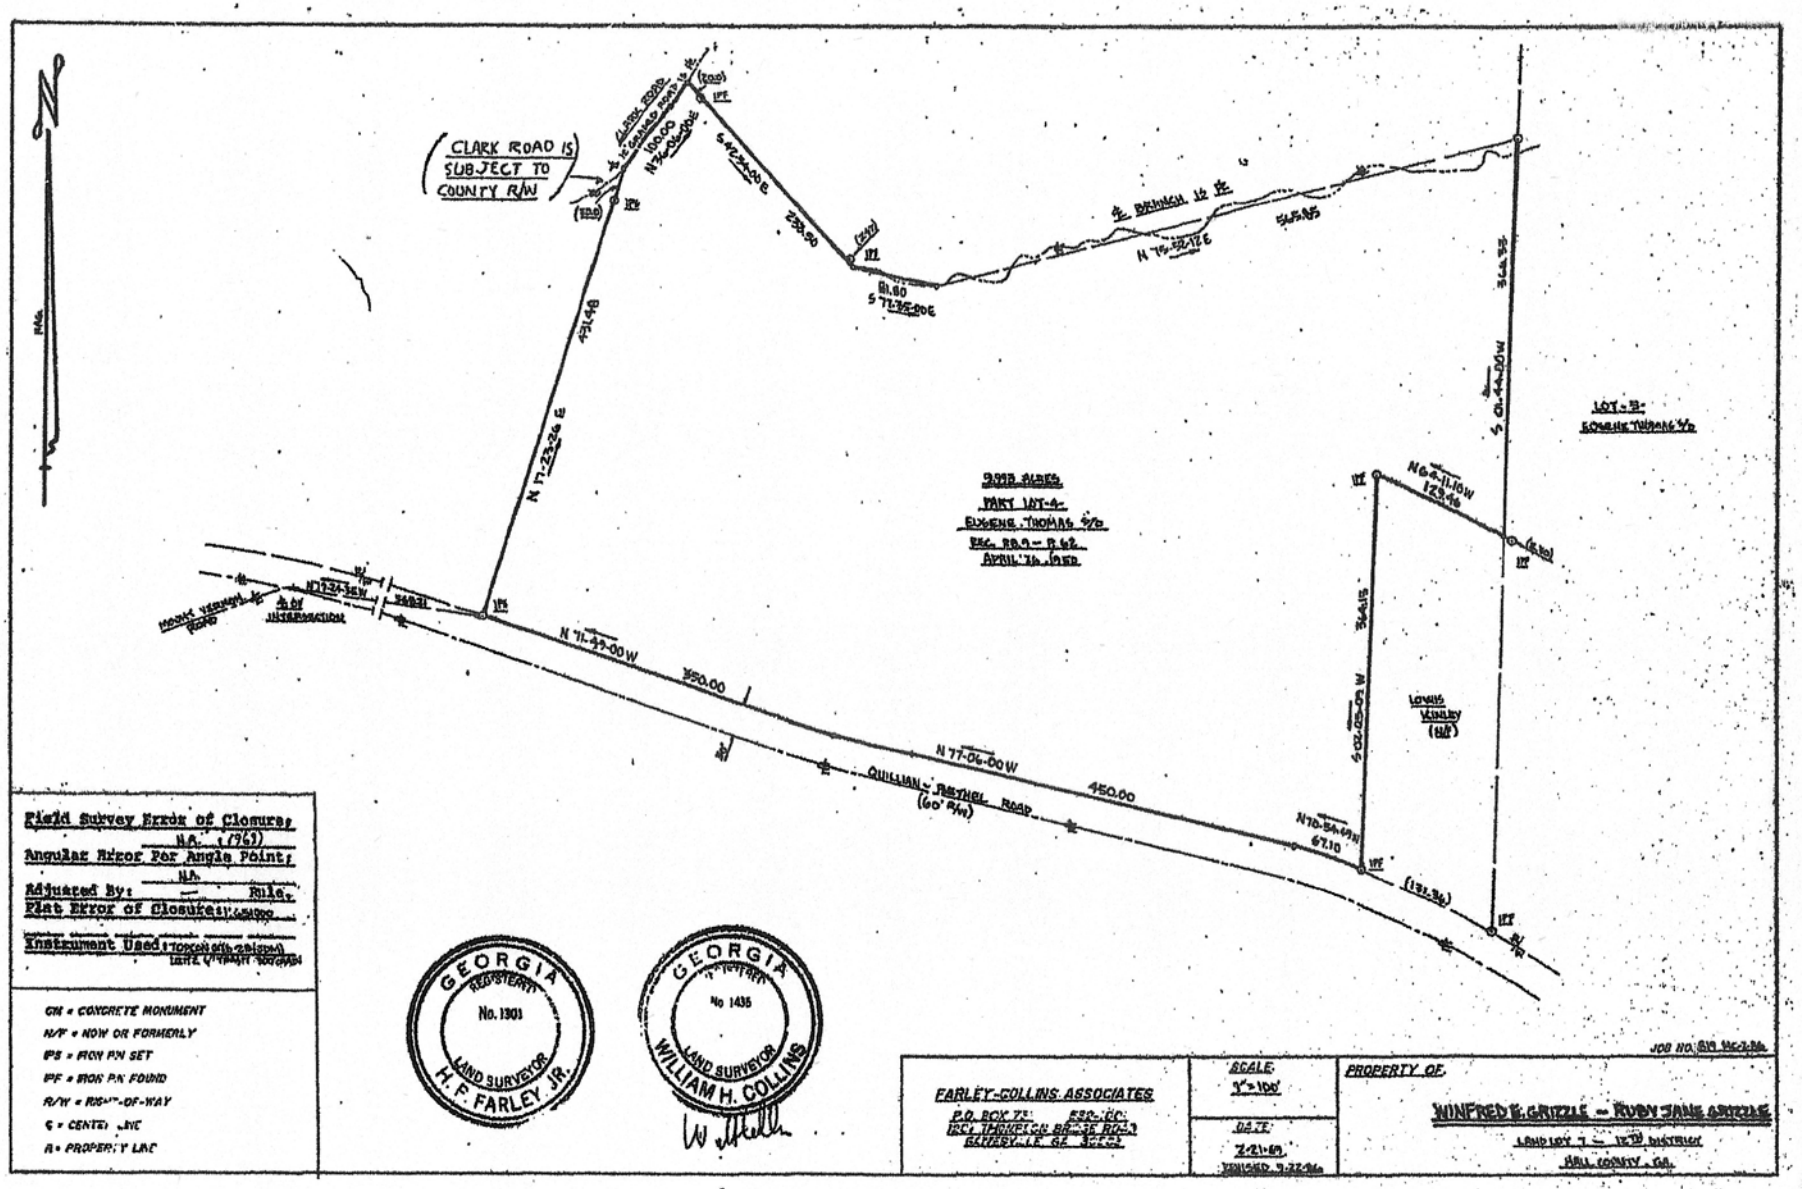

Field Survey Error of Closure: N.A. (1961)
Angular Error Per Angle Point: N.A.
Adjusted By: — Rule.
Plat Error of Closure: 1:[illegible]
Instrument Used: TOPCON [illegible]

Recorded October 23, 1986 Dwight S. Wood, Clerk