



## Water Heater Stand

For compliance with National Fuel Gas Code Z223. 1-1980, Section 5.1.9 Installation in Residential Garages.

- Gas utilization equipment in residential garages shall be installed so that all burners and burner ignition devices are located not less than 18 inches above the floor.
- Such equipment shall be located, or protected, so it is not subject to physical damage by a moving vehicle.

**WARNING:** Do not store hazardous materials in immediate area around water heater.


**Material Type:** Galvanized Steel - ASTM A653 CS Type B, G40 Coating



		A	B	C
Model	Gauge	Length	Width	Height
83180	18	21"	21"	18"
83181	16	24"	24"	18"


### STEP 1:

Turn platform upside down as shown in Figure 1. Secure legs to platform with nuts and bolts provided.

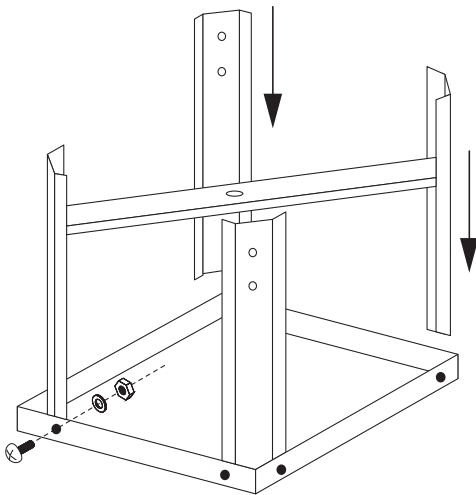

### STEP 2:

Insert first spreader with "U" channel face down. Fasten to lower bolt holes in legs. Insert 2nd spreader with "U" channel upwards. Secure into top holes in legs. Join spreader centers with nut and bolt.

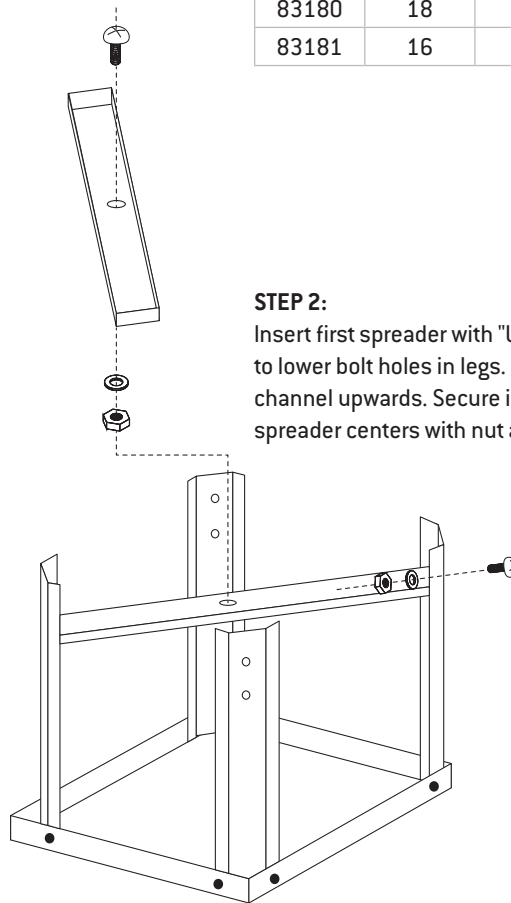

PRODUCT	DESCRIPTION	MODEL	UNITS/CASE
83180	18-Gauge 21" x 21" x 18" Stand For use with water heaters having a 21" diameter or less. <b>Max Capacity of stand is 650 lbs.</b>	WHS1	1
83181	16-Gauge 24" x 24" x 18" Stand For use with water heaters having a 24" diameter or less. <b>Max Capacity of stand is 1,300 lbs.</b>	WHS2	1



500 Distribution Parkway, Collierville, TN 38017 • Phone: 800-888-8312 • Fax: 901-853-5008 • [www.ipscorp.com](http://www.ipscorp.com)